

Eurofins TestAmerica, Savannah  
 5102 LaRoche Avenue  
 Savannah, GA 31404  
 Phone: 912-354-7558 Fax: 912-352-0165

Chain of Custody Record


eurofins | Environment Testing  
 America

**Client Information**  
 Client Contact: **Craig Reeder** Phone: **709-225-7302**  
 Company: **Union County Public Schools**  
 Address: **400 N Church St**  
 City: **Monroe** State: **Zip NC, 28110**  
 Email: **craig\_reeder@ucps.k12.nc.us**  
 Project Name: **Lead in Drinking Water**  
 Site: **SSOM#**

**Sample Information**  
 Sample ID: **709-225-7302**  
 Lab File: **Barnett, Eddie T**  
 E-Mail: **Eddie.Barnett@eurofins.com**  
 Customer Tracking File(s):  
 Job #: **680-118263-45180-9**  
 Page: **9 of 9**

**Analysis Requested**  
 Field Filtered Sample (Yes or No)  
 Perform MS/MSD (Yes or No)  
**200.8 - (MOB) Total Lead**

Sample Identification	Sample Date	Sample Time	Sample Type (C-Comp, G-Controll)	Matrix (Element, Swirl, Chemical)	Preservation Codes	Total Number of containers	Special Instructions/Note
1. <b>Henby Bridge 3compartment sink</b>	4-5-21	1:21P	G	Water			
2. <b>Henby Bridge Food Prep</b>	4-5-21	1:23P	G	Water			
3. <b>Henby Bridge Steamer</b>	4-5-21	1:25P	G				
4. <b>Henby Bridge Kettle</b>	4-5-21	1:28P	G				
5. <b>Henby Bridge Boiling Pan</b>	4-5-21	1:31P	G				

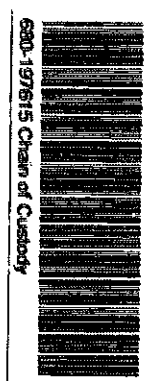


**Possible Hazard Identification**  
 Non-Hazard  Flammable  Skin Irritant  Poison B  Unknown  Radioactive  
 Deliverable Requested: I, II, III, IV, Other (Specify)  
 Empty Kit Relinquished by: \_\_\_\_\_ Date: \_\_\_\_\_  
 Relinquished by: \_\_\_\_\_ Date/Time: \_\_\_\_\_ Company: \_\_\_\_\_  
 Relinquished by: \_\_\_\_\_ Date/Time: \_\_\_\_\_ Company: \_\_\_\_\_  
 Relinquished by: \_\_\_\_\_ Date/Time: \_\_\_\_\_ Company: \_\_\_\_\_

**Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)**  
 Return To Client  Disposed By Lab  Archive For \_\_\_\_\_ Months  
 Special Instructions/Notes: Requirements  
 Received By: **Wade White** Date/Time: **4/14/21** Company: **T4**  
 Received By: \_\_\_\_\_ Date/Time: \_\_\_\_\_ Company: \_\_\_\_\_  
 Received By: \_\_\_\_\_ Date/Time: \_\_\_\_\_ Company: \_\_\_\_\_

Custody Seals Intact: **A Yes A No** Custody Seal No.: \_\_\_\_\_  
 Cooler Temperature(s) °C and Other Remarks: **21.8/21.9 °C #27**

- 1. 3 Compartment Sink
- 2. Food Prep
- 3. STEAMER
- 4. KETTLE
- 5. Braising Pan

↑↑  
H.I.D. DOOR  
NON-H.I.D. DOOR

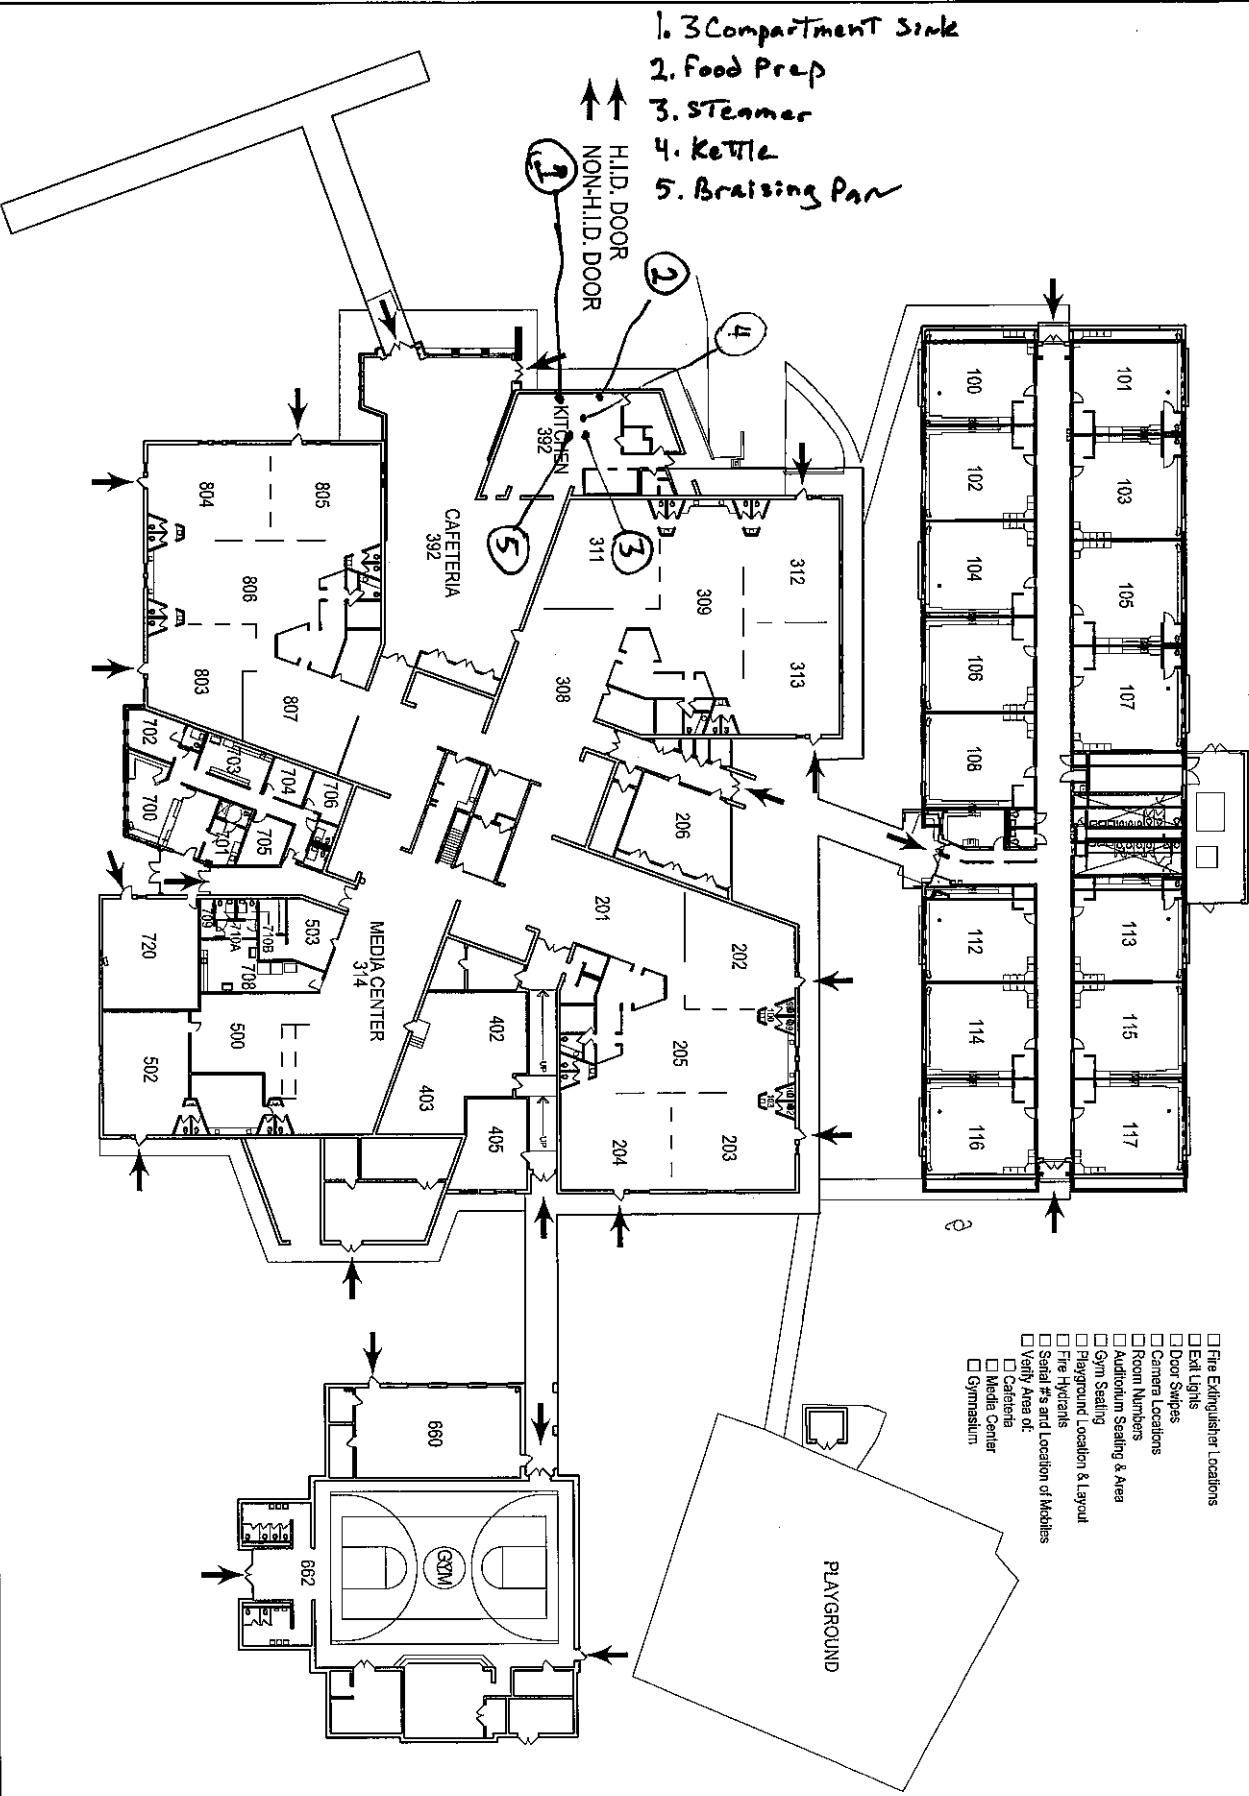

- Fire Extinguisher Locations
- Exit Lights
- Door Swipes
- Camera Locations
- Room Numbers
- Auditorium Seating & Area
- Gym Seating
- Playground Location & Layout
- Fire Hydrants
- Serial #'s and Location of Meshes
- Verify Area of
- Cafeteria
- Media Center
- Gymnasium

**SITE**

**FLOOR PLAN**

DATE: 10 JUNE 2014

REVISIONS:

SCALE: NTD TO SCALE

PROPERTY ACCOUNTING SITE SURVEY

PROJECT DESCRIPTION:

**HEMBY BRIDGE  
ELEMENTARY SCHOOL**

6701 INDIAN TRAIL-FAIRVIEW RD  
INDIAN TRAIL, NC 28079

**UCPS**  
UNION COUNTY PUBLIC SCHOOLS

Globalization. Innovation. Graduation.

## Client Sample Results

Client: Union County Public Schools  
 Project/Site: Lead in Drinking Water - Hemby Bridge

Job ID: 680-197615-1

**Client Sample ID: Hemby Bridge 3 Compartment Sink**

**Lab Sample ID: 680-197615-1**

Date Collected: 04/05/21 13:21

Matrix: Water

Date Received: 04/14/21 12:30

**Method: 200.8-1994 R5.4 - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.060	U	0.30	0.060	ug/L		04/15/21 12:22	04/15/21 19:33	1

5

**Client Sample ID: Hemby Bridge Food Prep**

**Lab Sample ID: 680-197615-2**

Date Collected: 04/05/21 13:23

Matrix: Water

Date Received: 04/14/21 12:30

**Method: 200.8-1994 R5.4 - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.21	J	0.30	0.060	ug/L		04/15/21 12:19	04/15/21 13:38	1

**Client Sample ID: Hemby Bridge Steamer**

**Lab Sample ID: 680-197615-3**

Date Collected: 04/05/21 13:25

Matrix: Water

Date Received: 04/14/21 12:30

**Method: 200.8-1994 R5.4 - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.36		0.30	0.060	ug/L		04/15/21 12:19	04/15/21 13:55	1

**Client Sample ID: Hemby Bridge Kettle**

**Lab Sample ID: 680-197615-4**

Date Collected: 04/05/21 13:28

Matrix: Water

Date Received: 04/14/21 12:30

**Method: 200.8-1994 R5.4 - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.28	J	0.30	0.060	ug/L		04/15/21 12:22	04/15/21 19:24	1

**Client Sample ID: Hemby Bridge Braising Pan**

**Lab Sample ID: 680-197615-5**

Date Collected: 04/05/21 13:31

Matrix: Water

Date Received: 04/14/21 12:30

**Method: 200.8-1994 R5.4 - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.18	J	0.30	0.060	ug/L		04/15/21 12:22	04/15/21 19:27	1

# Client Sample Results

Client: Union County Public Schools  
 Project/Site: Lead in Drinking Water - Hemby Bridge

Job ID: 680-190815-1

**Client Sample ID: Hemby Bridge 1**

**Lab Sample ID: 680-190815-1**

Date Collected: 10/03/20 07:05

Matrix: Water

Date Received: 10/30/20 13:30

**Method: 200.8-1994 R5.4 - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.46		0.30	0.060	ug/L		11/02/20 14:55	11/02/20 20:09	1

**Client Sample ID: Hemby Bridge 2**

**Lab Sample ID: 680-190815-2**

Date Collected: 10/03/20 07:12

Matrix: Water

Date Received: 10/30/20 13:30

**Method: 200.8-1994 R5.4 - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.26	J	0.30	0.060	ug/L		11/02/20 14:55	11/02/20 20:13	1

**Client Sample ID: Hemby Bridge 3**

**Lab Sample ID: 680-190815-3**

Date Collected: 10/03/20 07:20

Matrix: Water

Date Received: 10/30/20 13:30

**Method: 200.8-1994 R5.4 - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.13	J	0.30	0.060	ug/L		11/02/20 13:54	11/02/20 17:51	1

**Client Sample ID: Hemby Bridge 4**

**Lab Sample ID: 680-190815-4**

Date Collected: 10/03/20 07:30

Matrix: Water

Date Received: 10/30/20 13:30

**Method: 200.8-1994 R5.4 - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.060	U	0.30	0.060	ug/L		11/02/20 13:44	11/02/20 17:28	1



### Client Sample Results

Client: Union County Public Schools  
Project/Site: Lead in Drinking Water - Hemby Bridge

Job ID: 680-191950-11

**Client Sample ID: Hemby Bridge 5**

**Lab Sample ID: 680-191950-35**

Date Collected: 11/19/20 14:08

Matrix: Water

Date Received: 11/24/20 13:40

**Method: 200.8-1994 R5.4 - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.6		0.30	0.060	ug/L		11/25/20 12:52	11/27/20 21:57	1

**Client Sample ID: Hemby Bridge 6**

**Lab Sample ID: 680-191950-36**

Date Collected: 11/19/20 14:08

Matrix: Water

Date Received: 11/24/20 13:40

**Method: 200.8-1994 R5.4 - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.11	J	0.30	0.060	ug/L		11/25/20 12:52	11/27/20 21:41	1

**Client Sample ID: Hemby Bridge 7**

**Lab Sample ID: 680-191950-37**

Date Collected: 11/19/20 14:08


Matrix: Water

Date Received: 11/24/20 13:40

**Method: 200.8-1994 R5.4 - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.80		0.30	0.060	ug/L		11/25/20 12:52	11/27/20 22:00	1



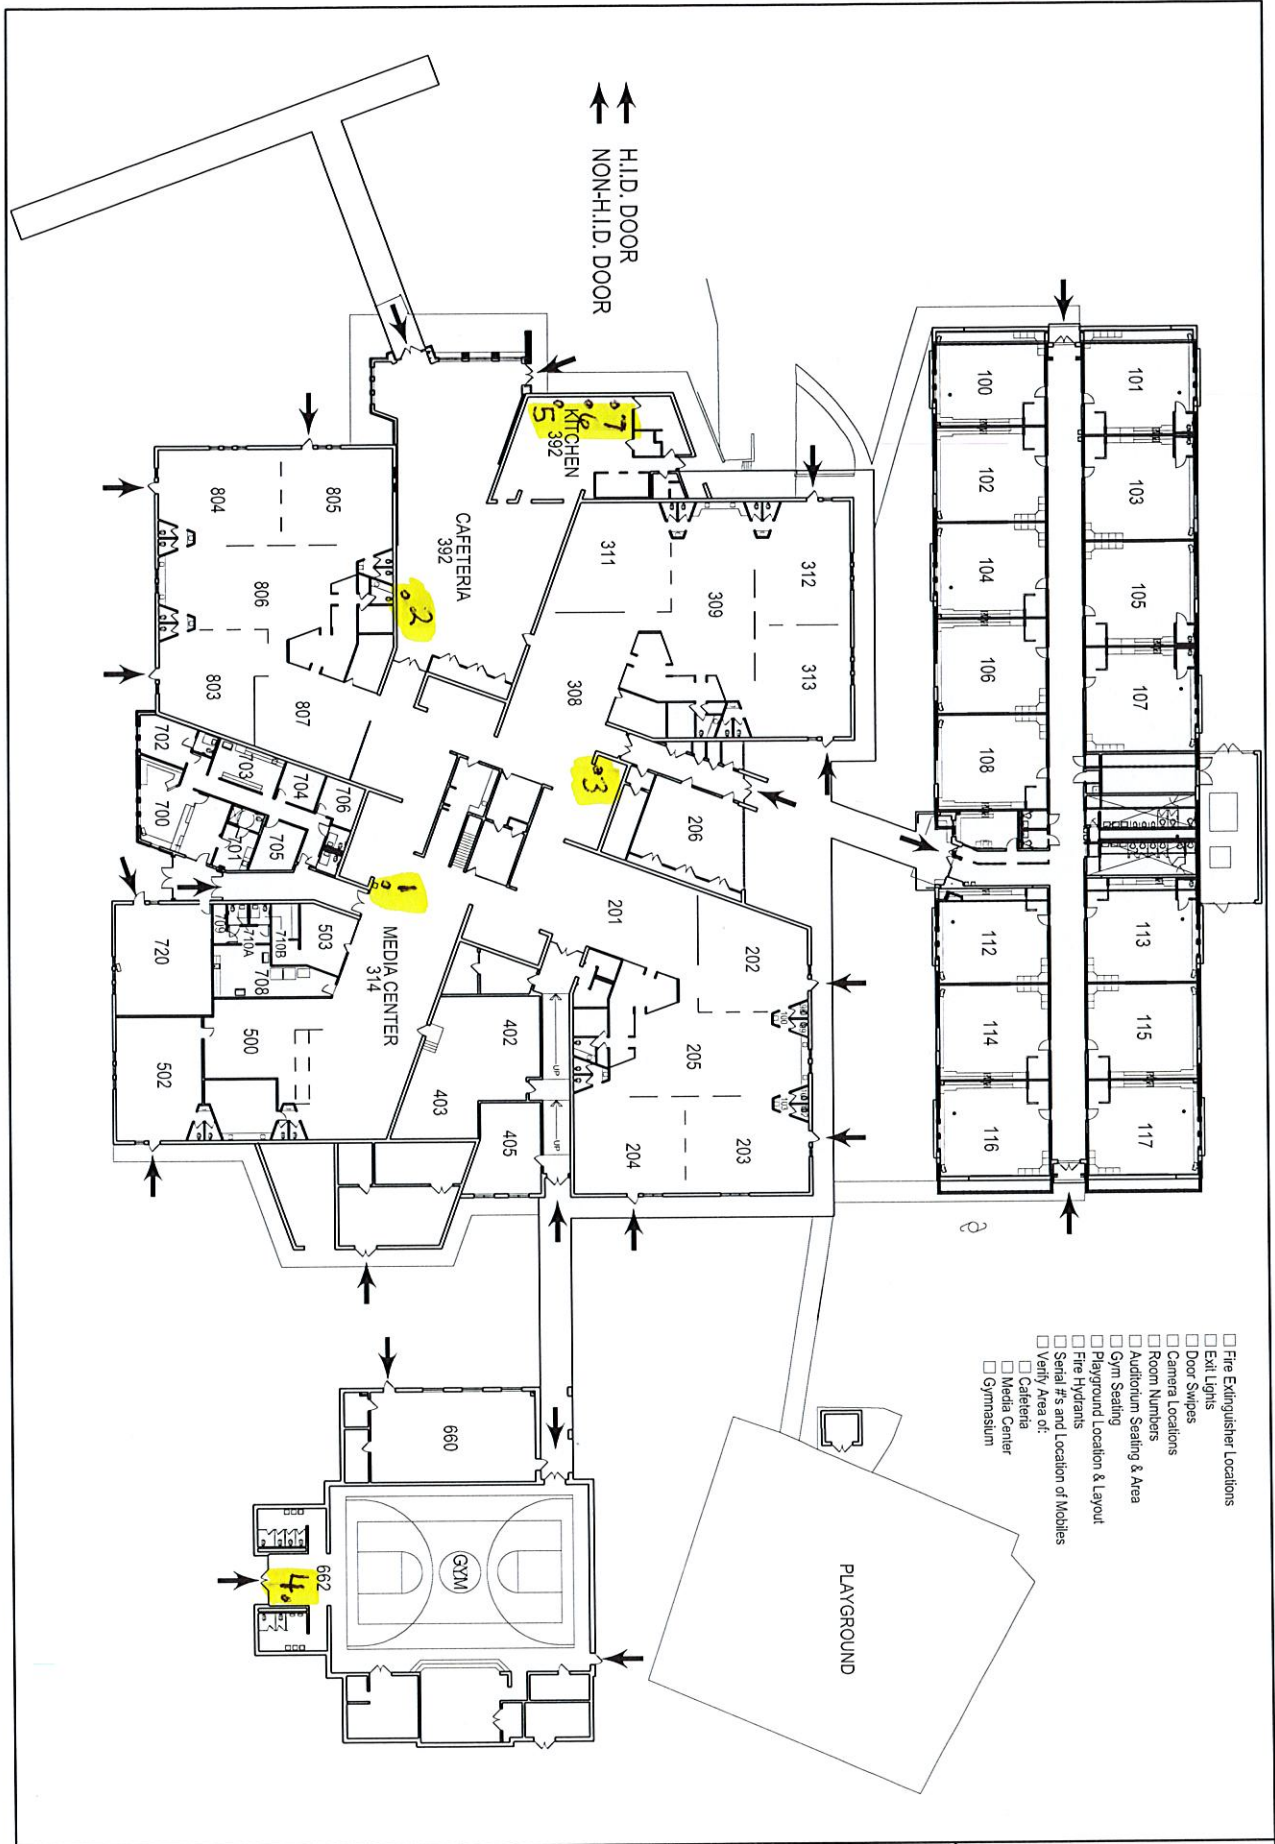

<b>SITE</b>	DATE: 10/06/2014
	SCALE: NOT TO SCALE
	REVISIONS:
	APPROVED:

**FLOOR PLAN**

**HEMBY BRIDGE  
ELEMENTARY SCHOOL**

6761 INDIAN TRAIL-FAIRVIEW RD  
INDIAN TRAIL, NC 28079



**UCPS**  
UNION COUNTY PUBLIC SCHOOLS

Globalization. Innovation. Graduation.